


RESTORING DEFAULT SETTINGS IN CHEMFFX

ChemFFX remembers the settings from the last login by a particular computer. If settings are changed by you or another user of your computer, then ChemFFX will behave differently until such time as you choose to reset the settings to default.

Step 1 Login to ChemFFX


Go to: <http://safety.unimelb.edu.au/unimelb-only/chemffx.html> [University network login required]

Step 2 Select the *Settings* button

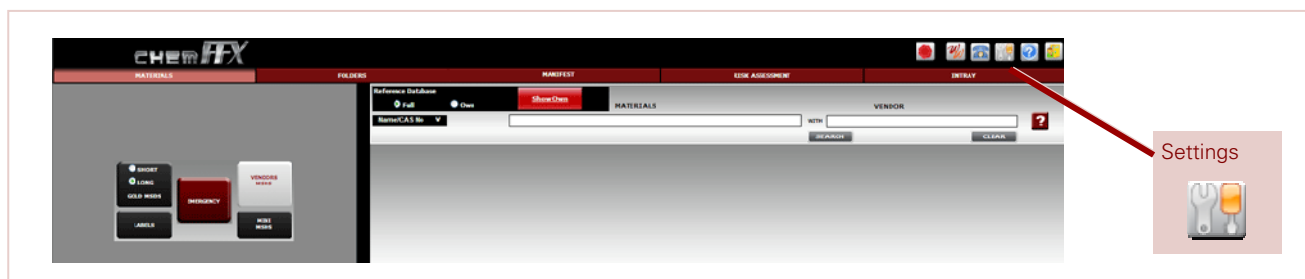


Step 3 Check settings and reset to default if desired

The default settings are shown in the illustration below. To change the settings manually, make your changes then press *Save*. To reset all settings to default, press *Reset*.

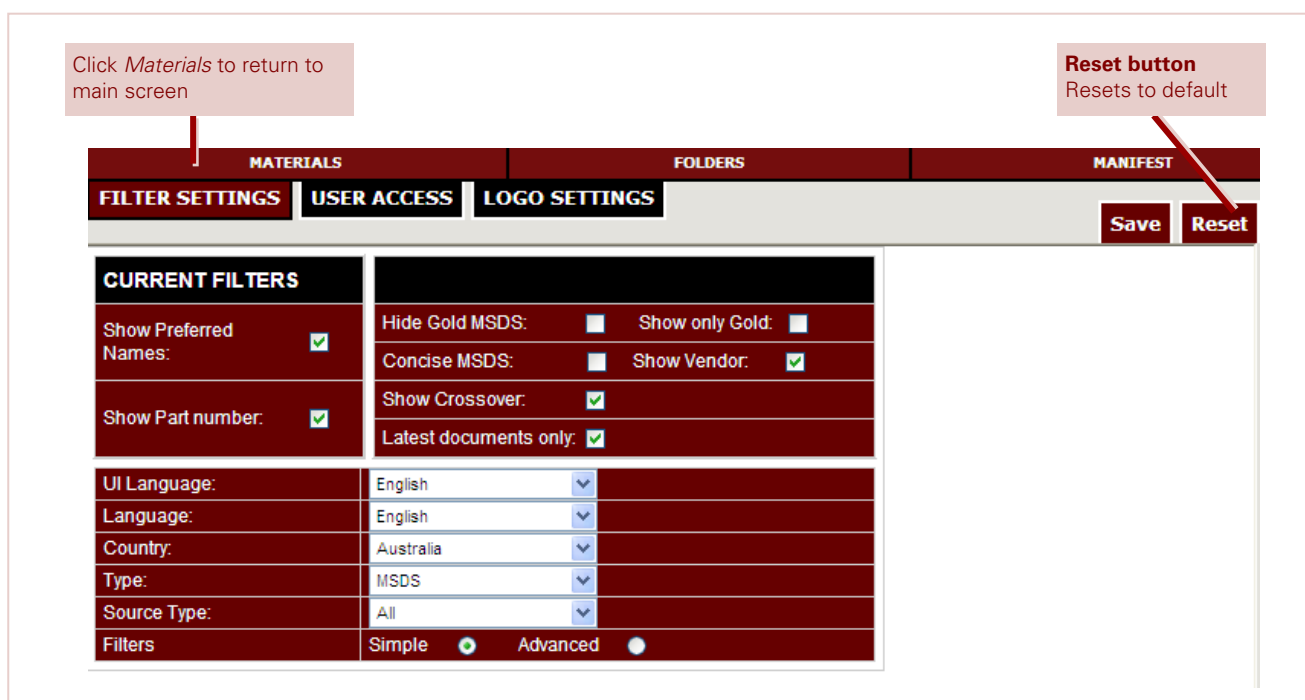

MORE HELP

- Further ChemFFX MSDS Database Quick Help cards: <http://safety.unimelb.edu.au/unimelb-only/chemffx.html> [University network login required]
- a detailed ChemFFX user guide is also available within the system via the help button: 
- Chemical Management webpage: <http://safety.unimelb.edu.au/topics/chemical/>
- or consult your Local EHS Contact – refer <http://safety.unimelb.edu.au/about/contacts/local.html>